



Rockwell International
Energy Systems Group

SUPPORTING DOCUMENT

GO NO.	S/A NO.	PAGE 1 OF	TOTAL PAGES	REV LTR/CHG NO SEE SUMMARY OF CHG	NUMBER
07704	44650	8	8	NC	N704TI990029
PROGRAM TITLE					
Decontamination and Disposition of Facilities					
DOCUMENT TITLE					
Radiological Survey Results - Release to Unrestricted Use, SRE Region III					
DOCUMENT TYPE			KEY NOUNS		
Technical Information			Decontamination		
ORIGINAL ISSUE DATE	REL. DATE		APPROVALS		DATE
	5-13-83		R. J. Tuttle <i>R. J. Tuttle</i>		4/27/83
PREPARED BY/DATE		DEPT	MAIL ADDR		
<i>J. H. Wallace</i> J. H. Wallace		779	T034		B. F. Ureda <i>B. F. Ureda</i> 4/22/83
IR&D PROGRAM? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		C. C. Conners <i>C. C. Conners</i> 4/25/83			
IF YES, ENTER TPA NO.		J. M. Marzec			
		W. R. McCurnin <i>W. R. McCurnin</i> 5/31/83			
		M. E. Remley <i>M. E. Remley</i> 9 May 83			
DISTRIBUTION			ABSTRACT		
*	NAME	MAIL ADDR			
*	C. C. Conners	NB02	The results of the radiological survey for Region III of the SRE facility are described. All survey results are below the applicable limits, indicating that this area may be released for unrestricted use.		
*	J. M. Harris	T055			
*	J. M. Marzec	T143			
*	W. R. McCurnin	T020			
*	M. E. Remley	NB13			
*	R. J. Tuttle	NB13			
*	B. F. Ureda	NB02			
*	J. H. Wallace	T034			
0055Y/reg			RESERVED FOR PROPRIETARY/LEGAL NOTICES		
* COMPLETE DOCUMENT			THIS REPORT MAY NOT BE PUBLISHED WITHOUT THE APPROVAL OF THE DOE OFFICE OF PATENT COUNSEL		
NO ASTERISK. TITLE PAGE/SUMMARY OF CHANGE PAGE ONLY			This report was prepared as an account of work sponsored by the United States Government. Neither the United States nor the United States Department of Energy, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.		



CONTENTS

	Page
1.0 Introduction.....	3
2.0 Surveys and Results.....	7
3.0 Conclusions.....	8

TABLES

1. Contamination/Radiation Limits.....	5
2. Survey Measurement Requirements.....	6

FIGURES

1. SRE Facility.....	4
----------------------	---



1.0 INTRODUCTION

This document covers Region III of the SRE facility (Figure 1). The area adjoins Building 163 (CERF) and comprises the entrance approach to the SRE complex.

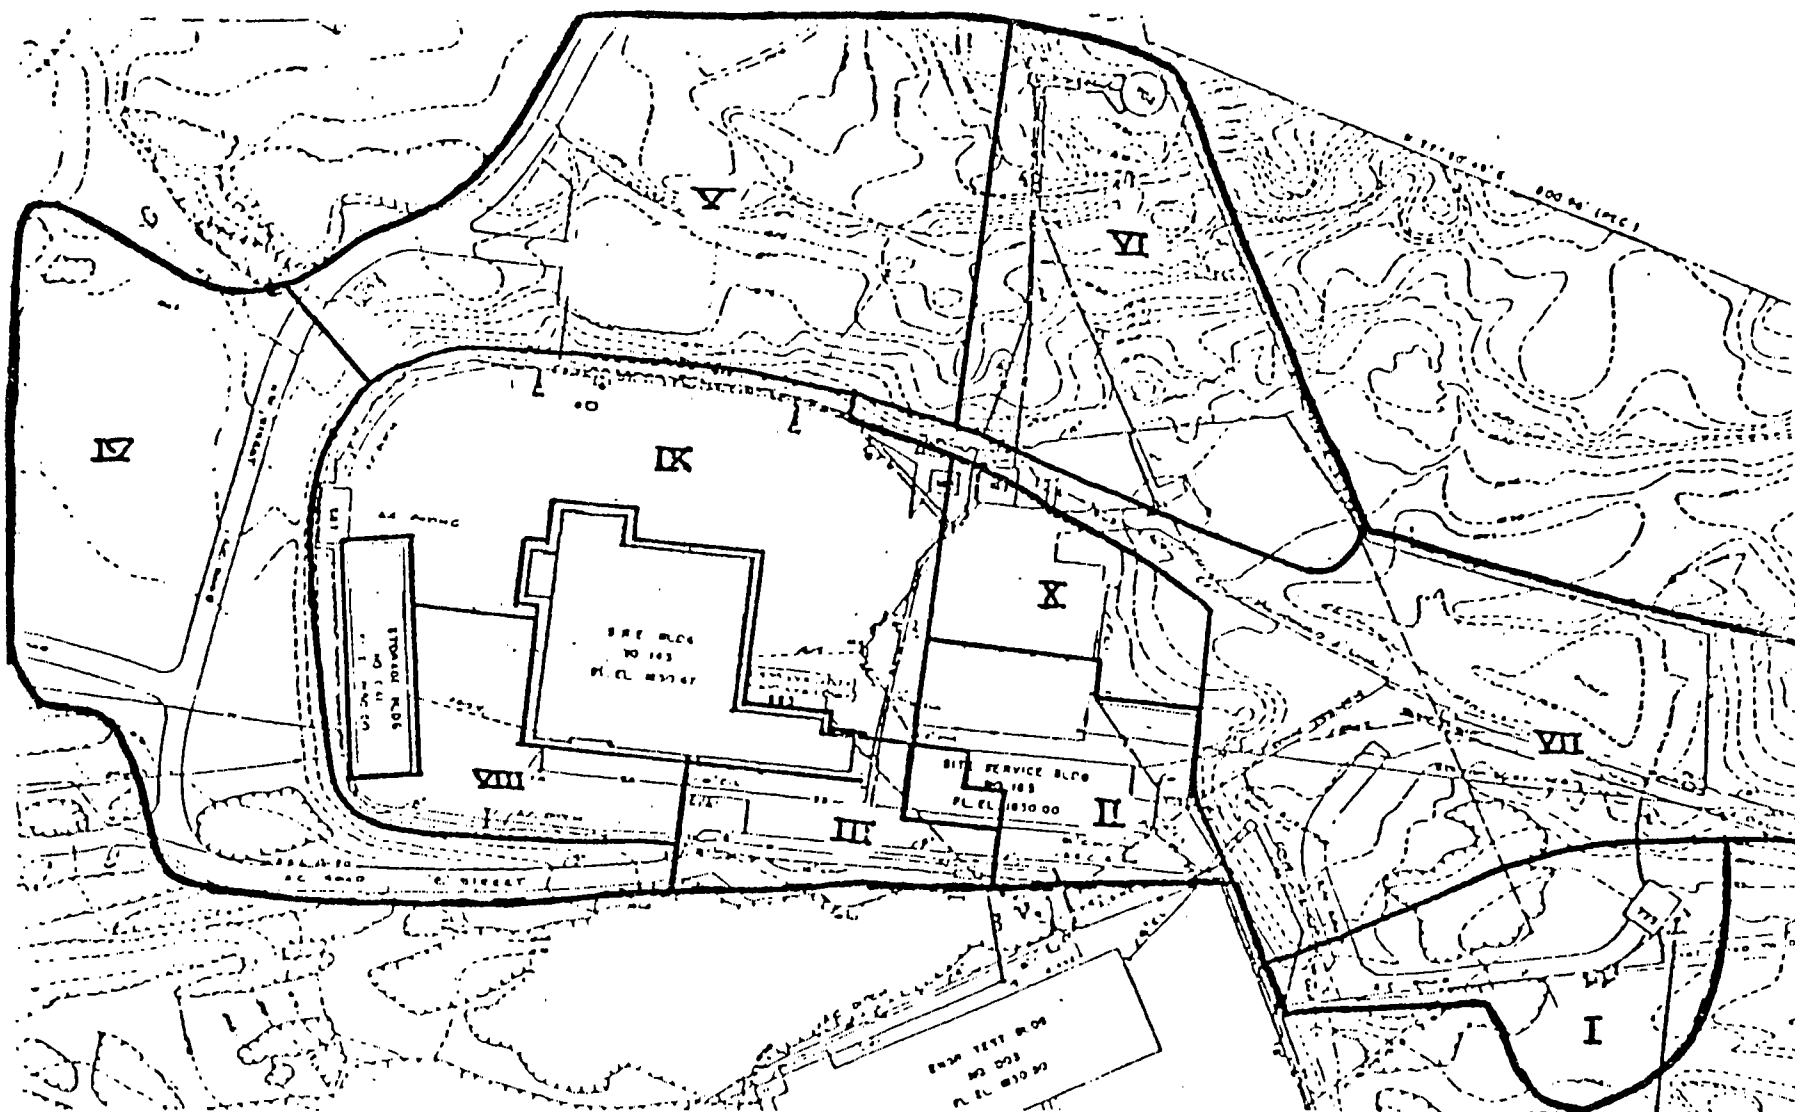


FIGURE 1
SRE FACILITY



The contamination/radiation limits for unrestricted use that were applied in decontaminating this area are shown in Table 1, and the requirements for survey measurements in each region are shown in Table 2.

TABLE 1
RESIDUAL RADIOACTIVITY LIMITS
FOR RELEASE FOR UNRESTRICTED USE

	Total	Removal
<u>Surfaces</u>		
Alpha	100 dpm/100 cm ²	20 dpm/100 cm ²
Beta	0.1 mrad/hr at 1 cm through 7 mg/cm ² absorber	100 dpm/100 cm ²
<u>Soil</u>	100 pCi/g gross detectable beta	



TABLE 2
SURVEY MEASUREMENT REQUIREMENTS

Region	Removal Contamination	Surface Radiation	Soil Samples	Concrete Samples	Water Samples
I	X	X	X	X	X
II	X	X	X		
III		X			
IV	X	X	X		
V		X	X	X	
VI		X	X		
VII		X	X		X
VIII		X			
IX	X	X	X		
X	X	X	X		
041	X	X			
063	X	X			
143 Offices	X	X			
143 High Bay	X	X	X	X	X

Measurements of removable contamination are omitted from those areas that consist solely of soil or asphalt-paved surfaces



2.0 SURVEYS AND RESULTS

A. SURFACE RADIATION

At the conclusion of the D&D effort, a survey was conducted using three survey instruments, a Technical Associates Model CP-7 ion chamber, a Ludlum Model 12 with a thin-window pancake GM detector, and an Eberline Model PRM-5-3 low-energy gamma detector. The Ludlum GM detector and Eberline low-energy detector were used for their faster response and audible output. The CP-7 showed an average reading of 0.04 mrad/h for Region III which is a typical reading in all uncontaminated areas at Santa Susana. All readings with the CP-7 were below the Table 1 limit of 0.1 mrad/h. Surveys were performed as specified in N704TP99008, "Radiological Survey Plan, Support of D/D Program Operation at T143, SRE," R. K. Owens. Copies of survey results and data sheets are retained by Radiation and Nuclear Safety.



3.0 CONCLUSIONS

In each type of test performed, all samples indicated levels less than those limits prescribed by the Decontamination and Disposition of Facilities Program for release for unrestricted use.

All appropriate surveys indicate that current existing radioactivity in the area is below the applicable limits for release for unrestricted use.